


**NOTES:**

- TO COMPLY WITH ANSI Z358.1-2009 FOR EMERGENCY EYEWASH OR EYE/FACE WASH AND SHOWER EQUIPMENT:
  - UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.
  - EYEWASH OR EYE/FACE WASH SHALL BE POSITIONED WITH NOZZLES NOT LESS THEN 83.8 CM (33 IN.) AND NO GREATER THAN 114.3 CM (45 IN.) FROM SURFACE ON WHICH USER STANDS AND 15.3 CM (6 IN.) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.
- UNIT MUST BE LEVEL FROM FRONT TO BACK AND SIDE TO SIDE.
- ALL THREE MOUNTING HOLES ON MOUNTING-BRACKET MUST BE USED TO PROPERLY SECURE EYEWASH UNIT TO WALL.
- \*DIMENSIONS MAY VARY ±1/2" [12.7mm].

**MODEL 7501 (SHOWN)**  
**MODEL 7501T/7501T240 - WITH HEATED JACKET**  
 (SEE SHEET 1 OF 2)

				1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM			
ECN NO. 5086	REVISED PER ECN: 5086	BY:	MODEL(S)	PORTABLE EYEWASH 7501/7501T/7501T240		PART NUMBER 0002080045.D REVISION 14	
DRAWN: MJ	DATE: 06/30/16	CHKD: VWC					
APPROVED: FV	DATE: 07/12/16	SCALE: 1:1	DRAWING TYPE: INSTALLATION	SIZE: A		SHEET 1 OF 2	

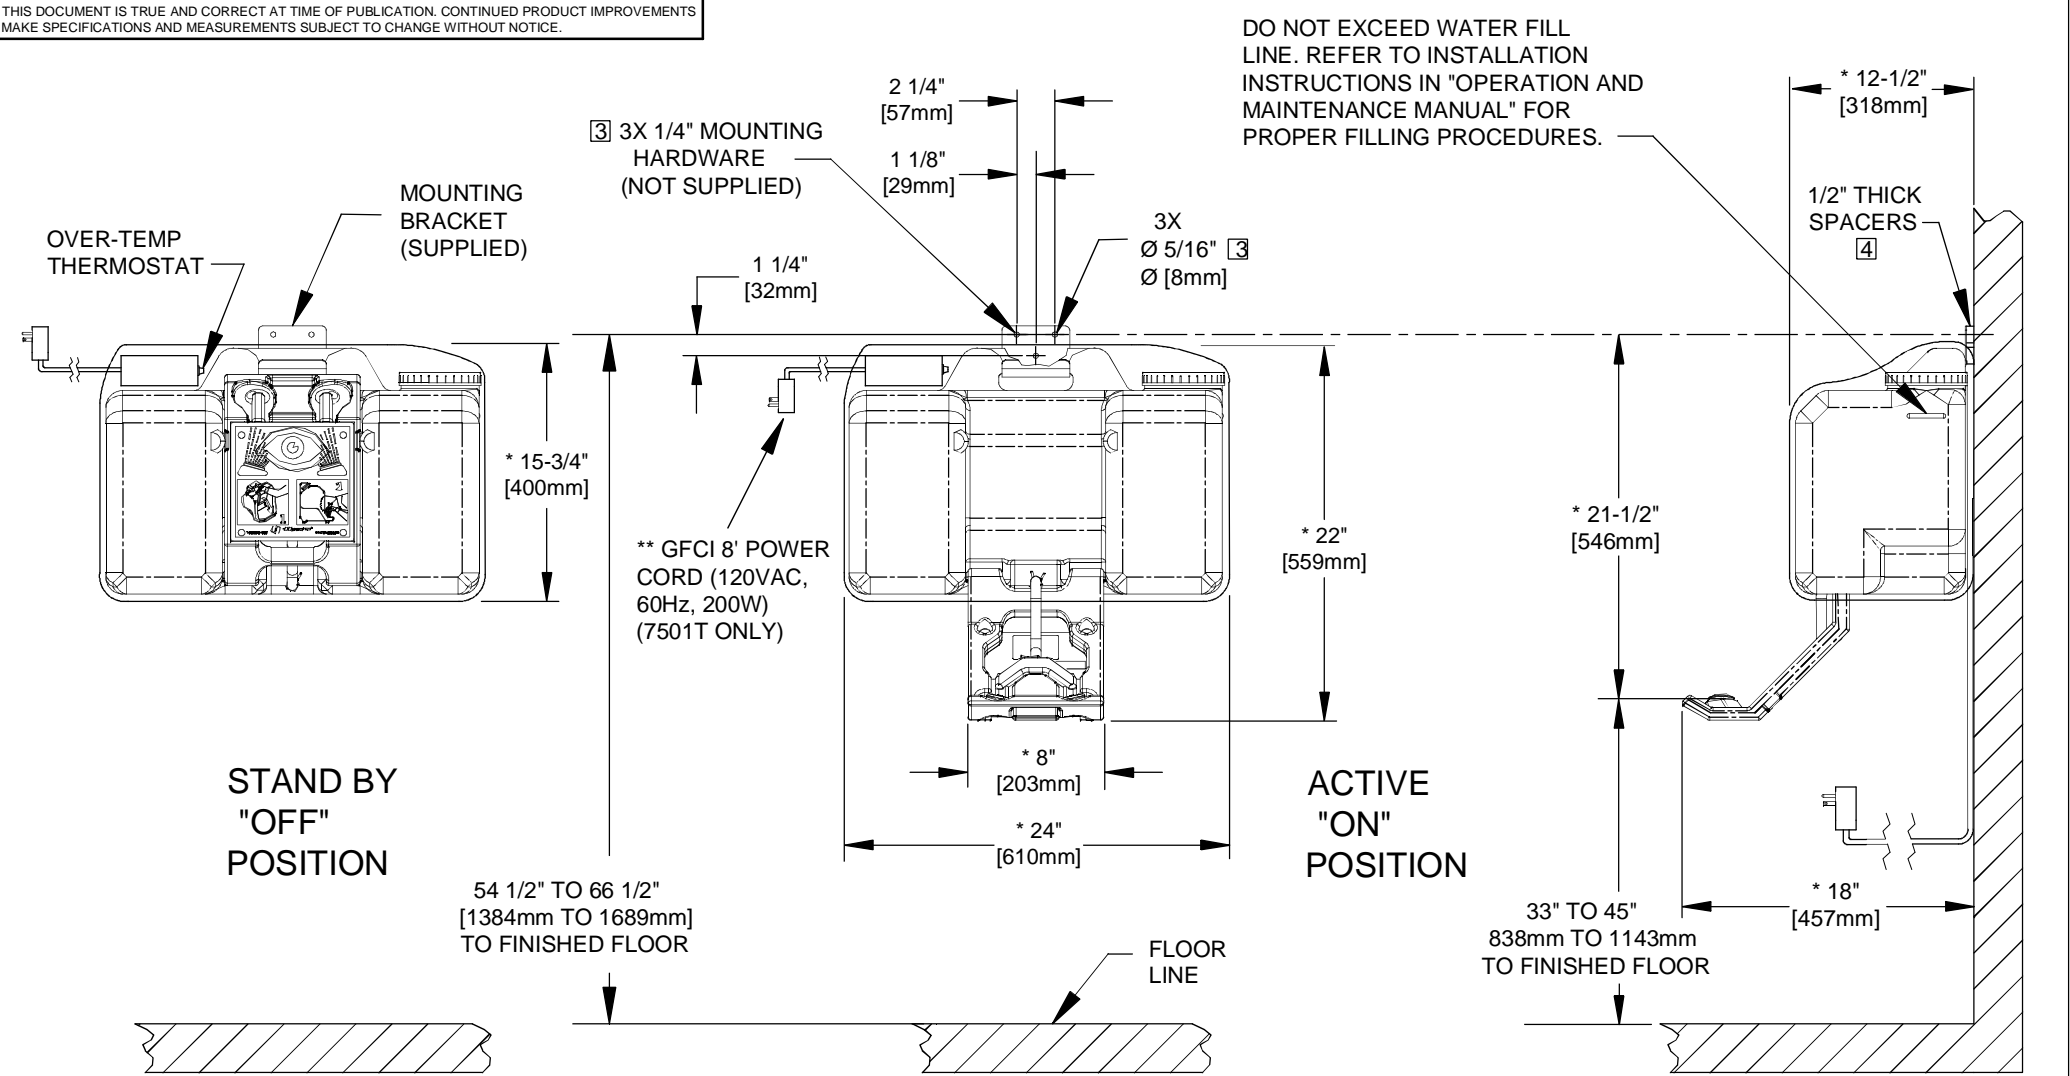

NOTES:

1. TO COMPLY WITH ANSI Z358.1-2009 FOR EMERGENCY EYEWASH OR EYE/FACE WASH AND SHOWER EQUIPMENT:
  - UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURE'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.
  - EYEWASH OR EYE/FACE WASH SHALL BE POSITIONED WITH NOZZLES NOT LESS THEN 83.3 CM (33 IN.) AND NO GREATER THAN 114.3 CM (45 IN.) FROM SURFACE ON WHICH USER STANDS AND 15.3 CM (6 IN.) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.
2. UNIT MUST BE LEVEL FROM FRONT TO BACK AND SIDE TO SIDE.
3. ALL THREE MOUNTING HOLES ON MOUNTING-BRACKET MUST BE USED TO PROPERLY SECURE EYEWASH UNIT TO WALL.
4. LOCATE ONE 1/2" THICK SPACER (QTY. 3 SUPPLIED) BEHIND EACH HOLE IN THE MOUNTING BRACKET AS SHOWN.
5. \* DIMENSIONS MAY VARY ±1/2" [12.7mm].
6. **\*\* UNIT MUST BE FILLED WITH WATER BEFORE CONNECTING TO POWER SOURCE.**  
(NOTES CONTINUED ON SHEET 3 OF 3)

MODEL 7501T/7501T240 - WITH HEATED JACKET  
(SHOWN)

MODEL 7501 (SEE SHEET 1 OF 2)

				1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWSO.COM WEBSITE: WWW.HAWSO.COM			
ECN NO. 5086	REVISED PER BY: ECN: 5086	MODEL(S)	PORTABLE EYEWASH 7501/7501T/7501T240		PART NUMBER 0002080045.D	REVISION 14	
DRAWN: MJ	DATE: 06/30/16	CHK'D: VWC	APPROVED: FV		DATE: 07/12/16	SCALE: 1:1	DRAWING TYPE: INSTALLATION
				SIZE: A		SHEET 2 OF 2	